



GREASE INTERCEPTOR – W.A.



Above-Ground - LARGE

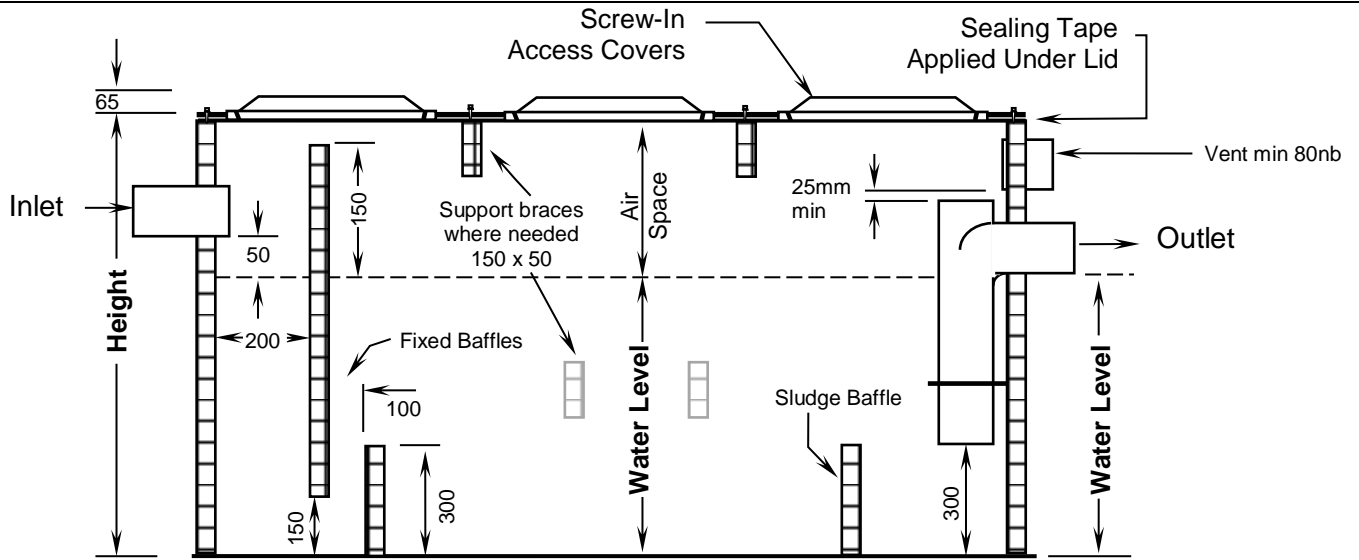

SECTION X-X

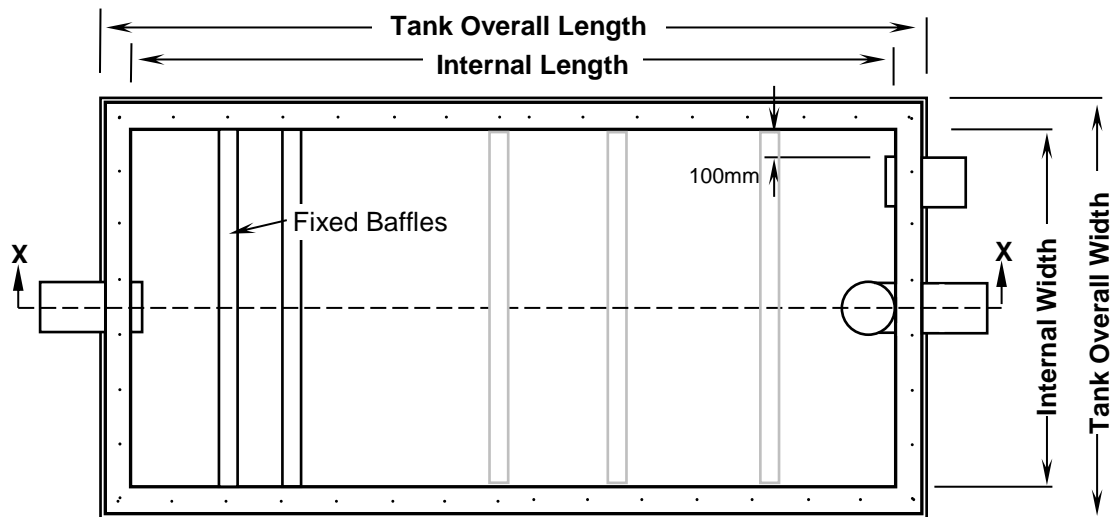

PLAN VIEW

(shown without lids)

NOTES:

- The interceptor, including baffles, is constructed of Paneltim construction panel. Pipe nozzles are HDPE.
- The interceptor is to be installed in a position that provides ready access for maintenance, inspection and cleaning purposes.
- Tanks must be installed according to Water Corp grease arrestor installation guidelines.
- The relevant authority must approve the proposed location of a grease interceptor prior to its installation.
- A program for regular maintenance and cleaning should be established with an authorised waste collection contractor.
- The tank design conforms to designs as issued by Water Corporation WA. We recommend the appropriateness of the tank design and its proposed location be verified for use by the local Water Authority prior to order placement.

Larger sizes and custom made tanks are available on request

Dimensions (mm)

Model	Capacity (litres)	Internal Dimensions				Overall Dimensions			Inlet dia	Outlet dia	Vent dia	Air Space
		Length	Width	Water	Height	Length	Width	Height				
(Sep 2017)												
WPT9AG2500	2,500	2800	900	1000	1300	2950	1030	1360	100	100	100	300
WPT9AG3000	3,000	3000	1000	1000	1300	3150	1130	1360	100	100	100	300
WPT9AG4000	4,000	3000	1350	1000	1300	3150	1480	1360	100	100	100	300
WPT9AG5000	5,000	3000	1500	1120	1420	3150	1630	1480	100	100	100	300
WPT9AG6000	6,000	3000	1800	1120	1420	3150	1930	1480	100	100	100	300
WPT9AG7500	7,500	3600	1800	1200	1500	3750	1930	1560	100	100	100	300
WPT9AG10000	10,000	4000	2000	1250	1550	4150	2130	1610	150	150	100	300

For further information, contact...

Viking Plastics Engineering Pty Ltd
143 Woodlands Drive, Braeside Vic 3195

Ph 03 9587 2297

E info@vikingplastics.com.au

Fx 03 9587 1172