


GREASE INTERCEPTOR



PANELTIM - Below-Ground - WA

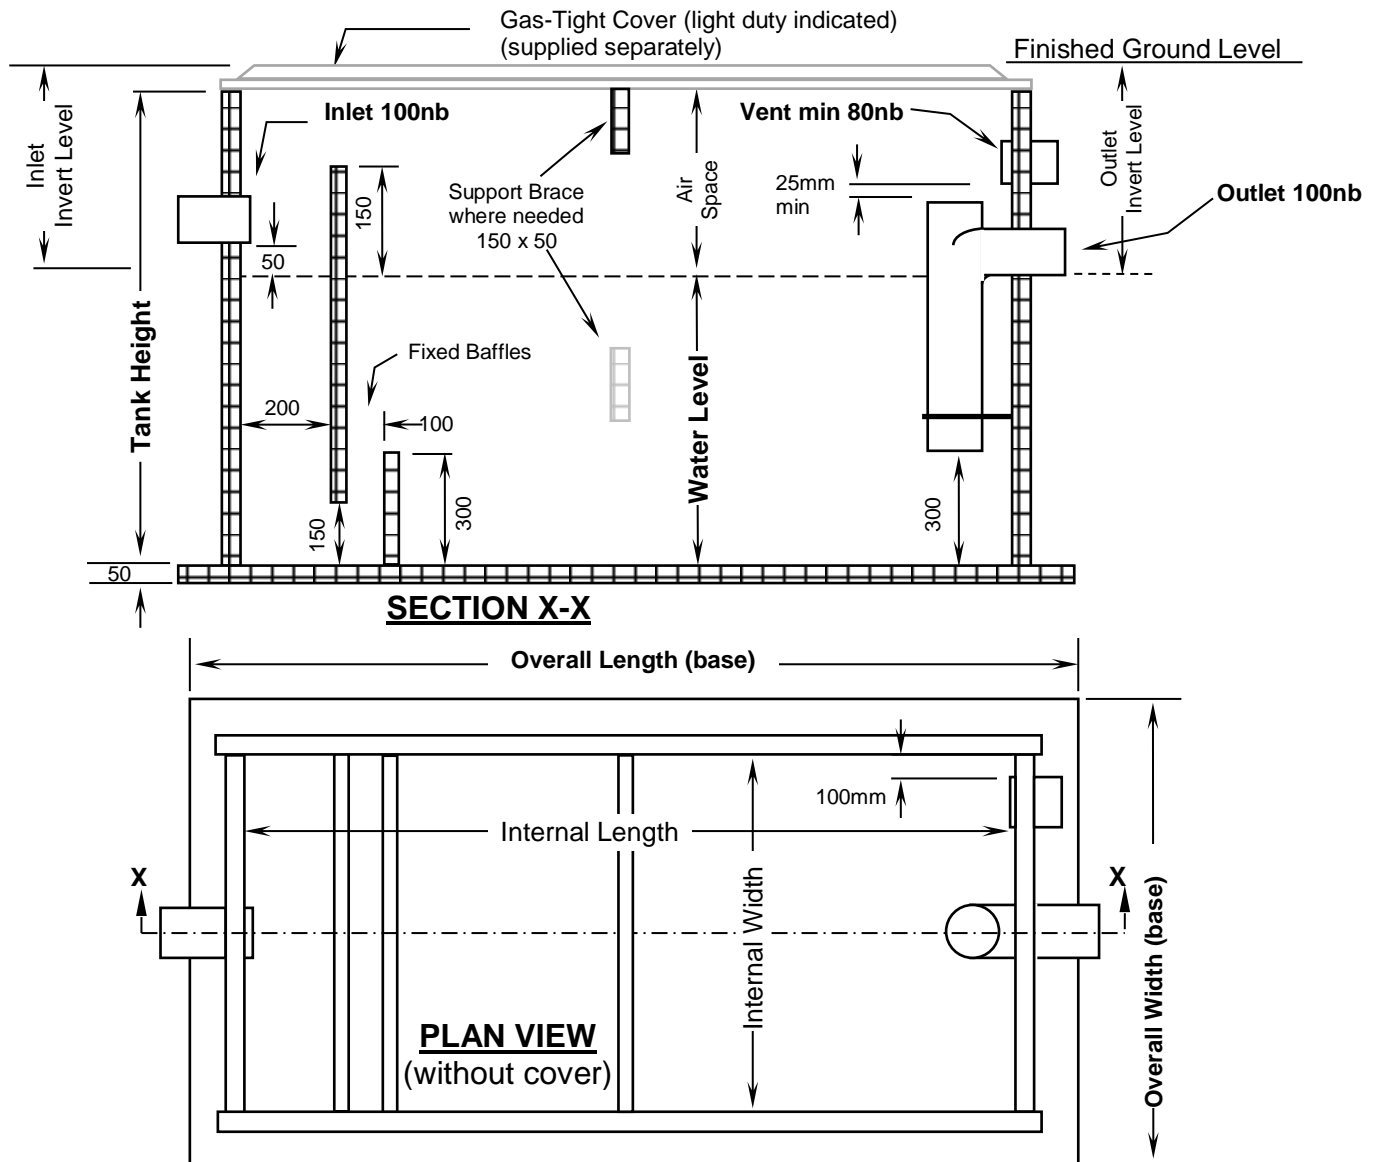

NOTES:

- The entire tank, including baffles, is constructed of Paneltim construction panel. Pipe nozzles are Polypropylene.
- Internal support braces are generally 150 x 50mm and the same width as the tank. They do not interfere with internal waste separation.
- Installation and burial procedures must be conducted in accordance with the Viking Paneltim Tank Installation Guidelines For Below-Ground Installations. Paneltim Tanks are designed and engineered to be installed without the need for concrete back-fill.
- Tanks must be installed according to Water Corp grease arrester installation guidelines.
- The relevant authority must approve the proposed location of a grease interceptor prior to its installation.
- A program for regular maintenance and cleaning should be established with an authorised waste collection contractor.
- The tank design conforms to approved design drawings as issued by Water Corporation WA. We recommend the appropriateness of the tank design and its proposed location be verified for use by the local Water Authority prior to order placement.

Larger sizes and custom made tanks are available on request.

Dimensions (mm)

Model (Sep 2017)	Capacity (litres)	Internal Dimensions				Overall Dimensions (base)			Inlet Invert Level	Outlet Invert Level	Cover Height	Air Space
		Length	Width	Water	Height	Length	Width	Height				
WPT9BG540	540	1250	750	600	900	1600	1000	950	310	360	60	300
WPT9BG730	730	1400	750	700	1000	1800	1000	1050	310	360	60	300
WPT9BG1000	1000	1400	750	960	1260	1800	1000	1310	310	360	60	300
WPT9BG1250	1250	1400	750	1200	1500	1800	1000	1550	310	360	60	300
WPT9BG1500	1500	1900	750	1100	1400	2400	1000	1450	310	360	60	300
WPT9BG2000	2000	2400	750	1120	1420	2800	1000	1470	310	360	60	300

For further information, contact...

Viking Plastics Engineering Pty Ltd
143 Woodlands Drive, Braeside Vic 3195

Ph 03 9587 2297

E info@vikingplastics.com.au

Fx 03 9587 1172