



# Integrated Water Supply Scheme: City of Joondalup - Craigie

## NOTICE OF PROPOSAL TO CONSTRUCT IWSS PERTH GROUNDWATER REPLENISHMENT STAGE TWO PLANT

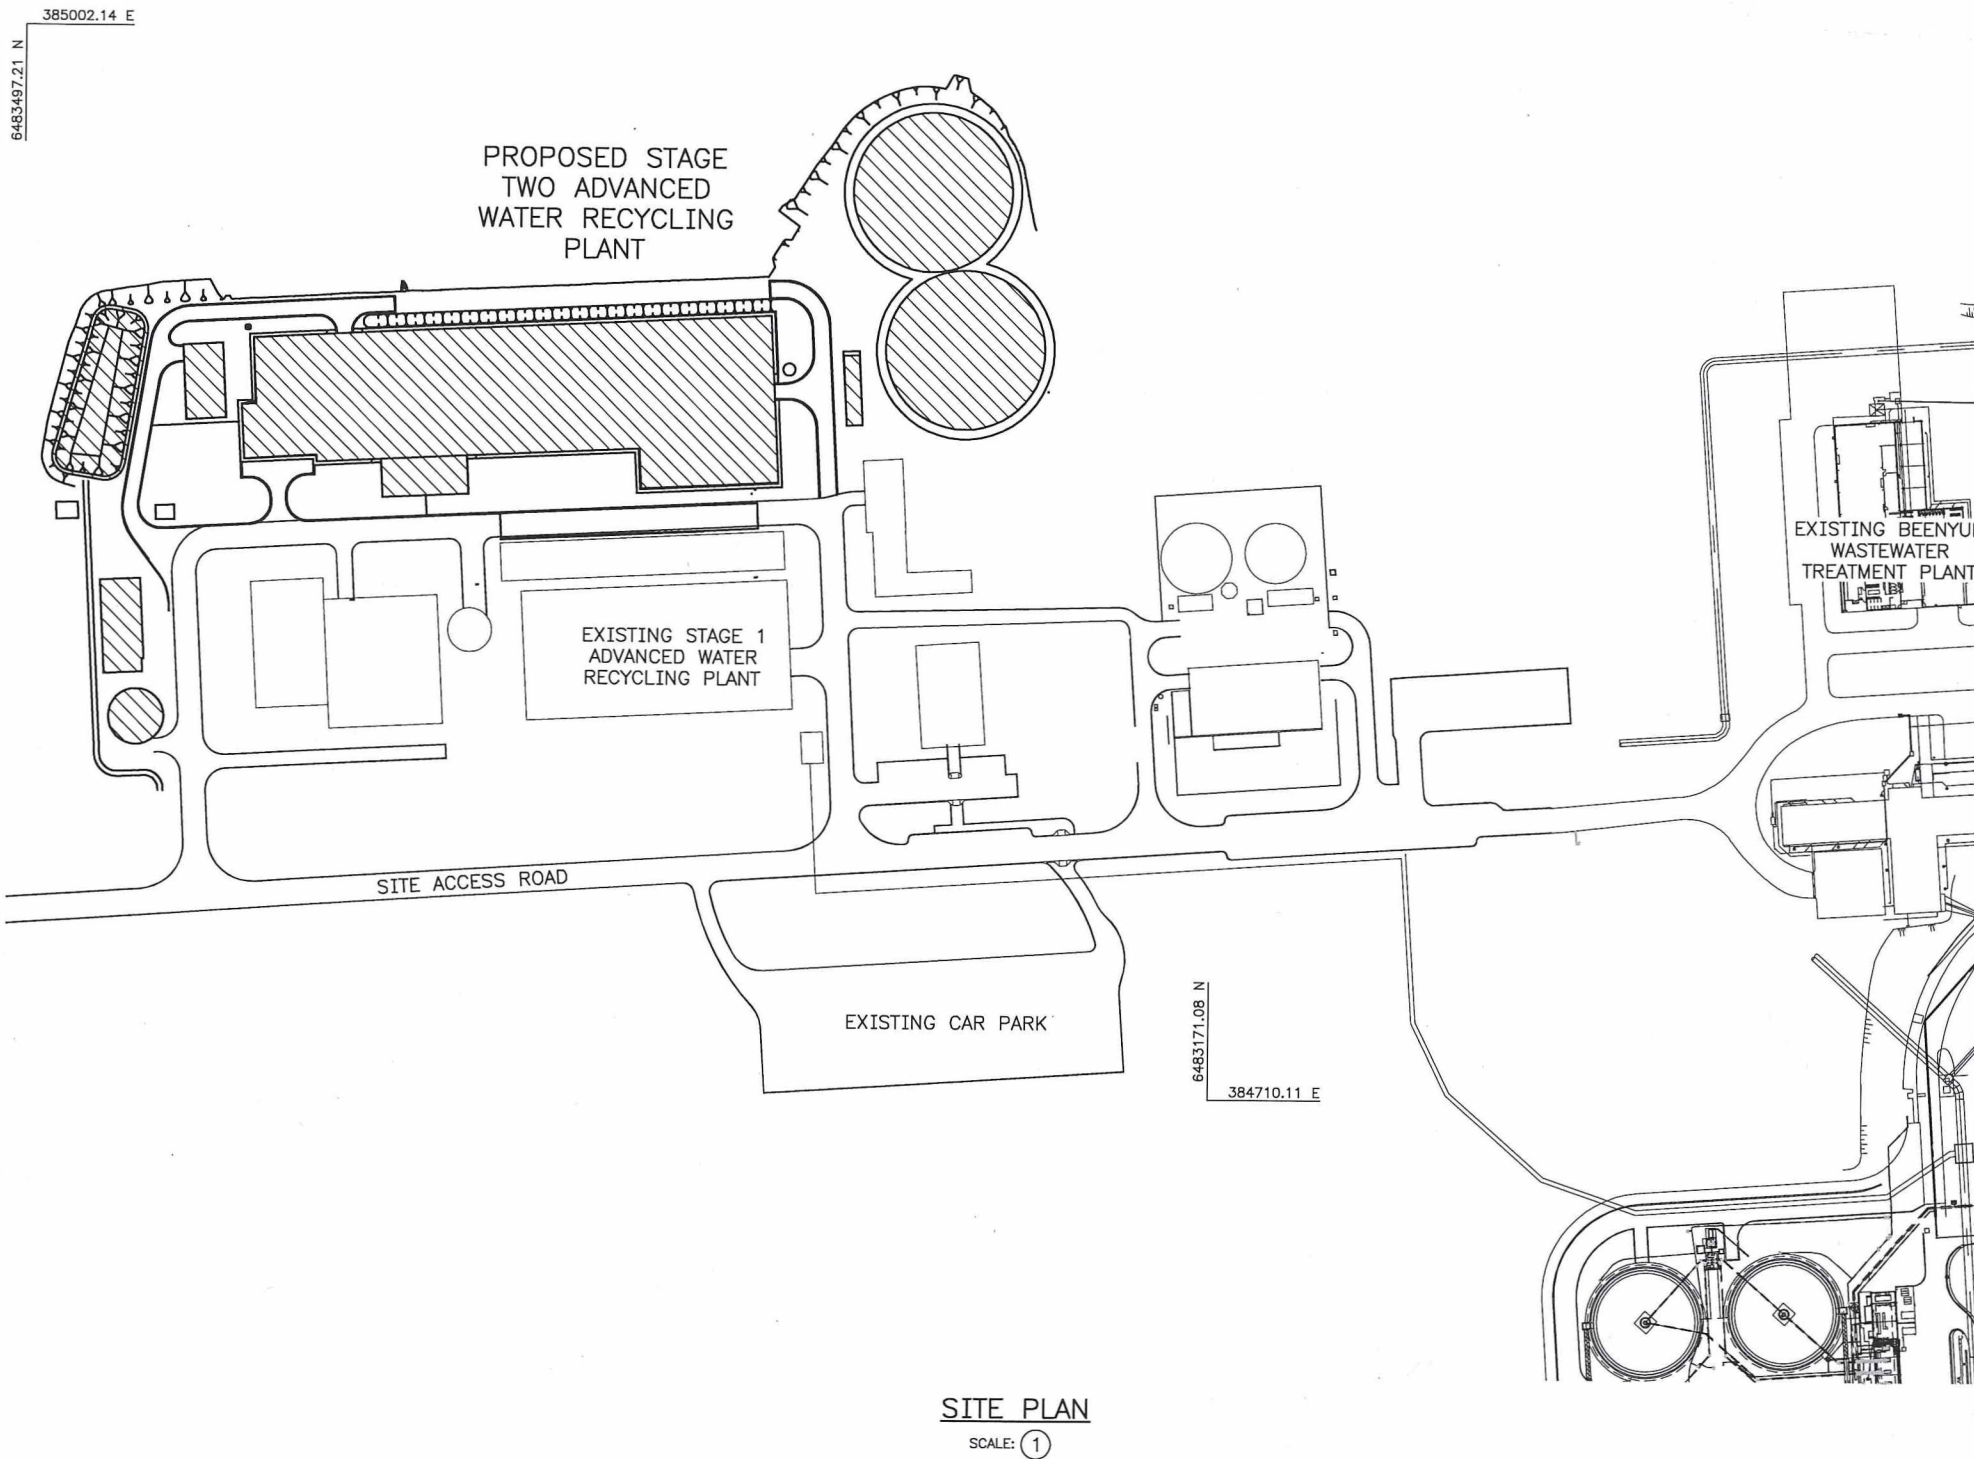

**SITE PLAN**  
SCALE: ①

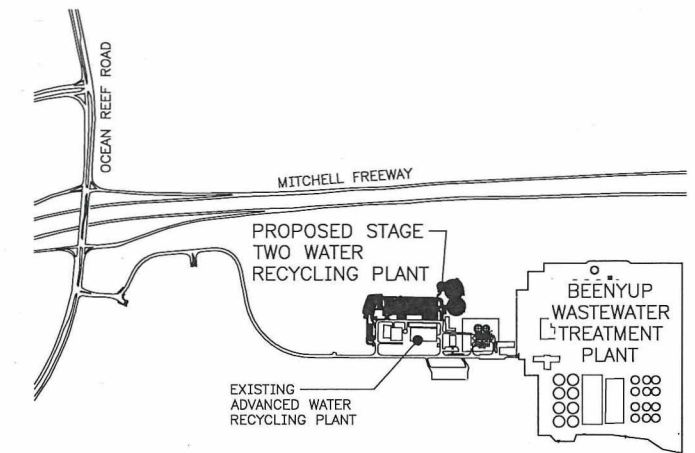

**LOCALITY PLAN**  
N.T.S.

To ensure future water security within the Integrated Water Supply Scheme, the Water Corporation proposes to increase the capacity of the Beenyup Advanced Water Recycling Plant. The upgrade will include construction of the following works:


- A screening, membrane filtration & reverse osmosis plant with a capacity of 14GL/year
- Ultraviolet disinfection facility
- Chemical dosing facility
- Balance tanks to supply both stage one and two plants;
- Recycled water transfer pump station
- Ancillary civil, electrical and mechanical assets in support of the above works
- Interconnecting pipework
- An interactive hub and visitors centre

The location of the proposed works is within the grounds of the Beenyup Wastewater Treatment Plant, as shown on the plan.

The proposed works are currently scheduled to commence in October 2017 and will continue for a duration of approximately two years.

A copy of this Notice of Proposal (referred to as LJ20-0-2) is available for viewing during office hours at Water Corporation's head office, John Tonkin Water Centre, 629 Newcastle Street, Leederville.

Further information may also be obtained by contacting the Project Manager, Jake Fraley, telephone (08) 9420 2149.



565		810		ISSUE	DATE	GRID	REVISION	DRN	REC	APPD	DESIGN SURVEY NONE	VERTICAL DATUM NONE	DES CALC DES CHD	NORTH POINT	RECOMMENDED 19/09/17			INTEGRATED WATER SUPPLY SCHEME IWSS PERTH GROUNDWATER REPLENISHMENT BEENYUP AWRP PREREQUISITES TO WORKS NOTICE OF PROPOSAL - MAJOR WORKS	ORIGINAL SHEET SIZE A1	
											ASCON SURVEY NONE	COORDINATE SYS MGAS4-50	DES REF	DRN P. MIRCO Q.C. CHD F. RACCUJA	APPROVED 19/09/17			FILE JT1 2016 04210 V01	PLAN LJ20-0-2	ISSUE A
											PROJECT C-W02788				19 SEP 2017		mircop0/WS25523			